


HORUS PRESSURE REGULATOR – ACTIVE MONITOR CONFIGURATION

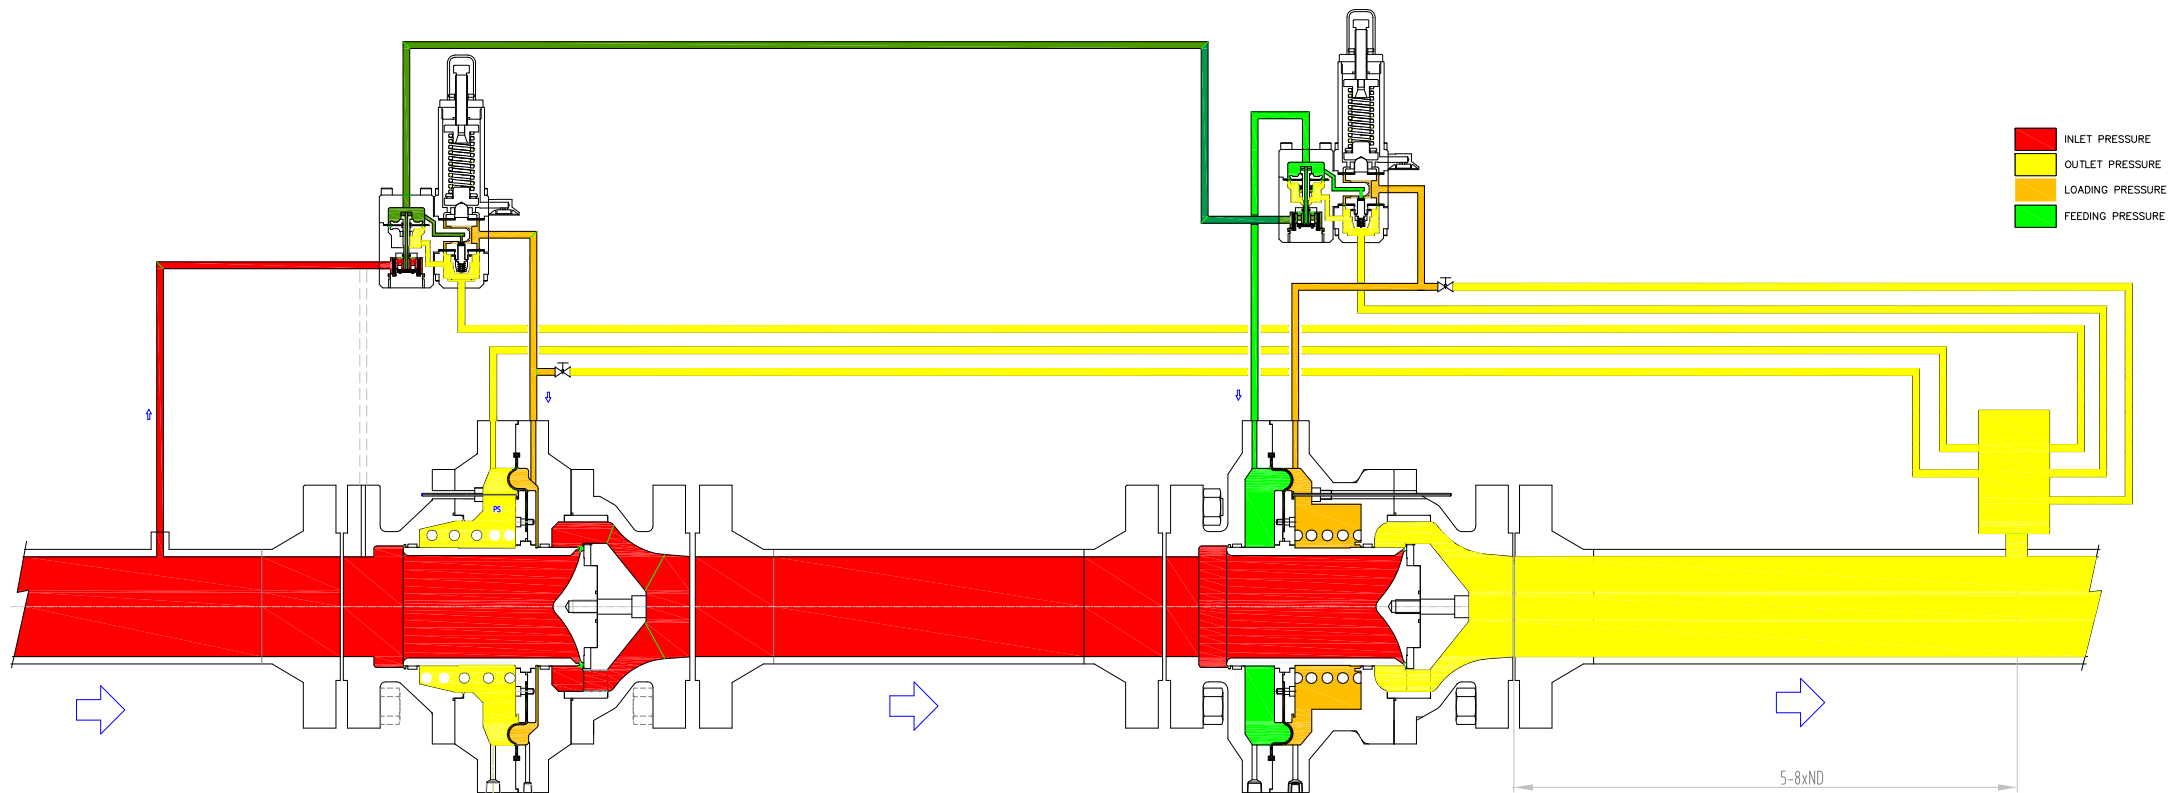

Note: Active Regulator – Fail Open

Monitor Regulator – Fail Close